


Construction notes:

1. This drawing should be read in conjunction with all other relevant drawings and specifications.
2. Exact positioning and orientation of resting places are to be agreed on site taking care to give specific view and shelter from wind and sun.
3. Resting place base and surface should be constructed as per relevant path surface type with maximum 2.5% (1:40) cross fall towards the back edge of the hard standing.
4. Minimum dimensions for resting place should be 3000mm long x 1500mm wide, preferred is 5000mm long x 2000mm wide.
5. Furniture should be installed minimum 1000mm back from the edge of the path surface and at least 300mm apart [1000mm apart for cycle stands] including 1000mm x 1000mm standing space for one wheelchair. Furniture should be installed into the ground with 150mm thick C16/20 concrete surround.



This standard detail is indicative only and not intended to be relied upon in specific site cases. A designer should satisfy themselves of site conditions and vary details and dimensions to suit. Paths for All accept no liability for any inaccuracies or for any loss, expense, damage or injury or accident arising from the use or application of information contained here in.

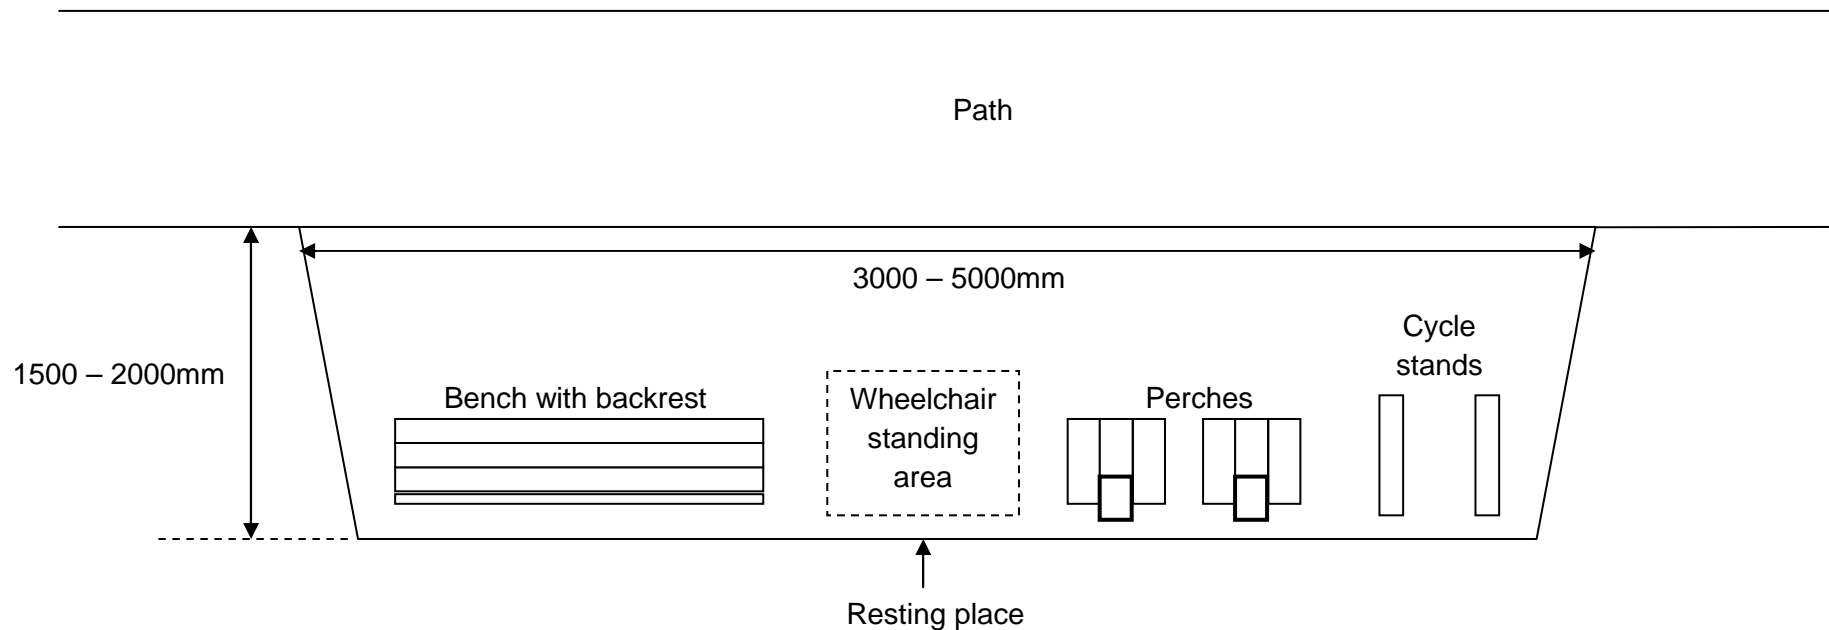

**Resting Place
Standard Detail**

Date: 06/02/12
Scale: Not to scale
Drawn by: Technical Officer
Drawing nr: SD/RP/01