
## Construction notes:

- 1. This drawing should be read in conjunction with all other relevant drawings and specifications.
- 2. Exact positioning of passing places are to be agreed on site.
- 3. Passing place base and surface should be constructed as per relevant path surface type with maximum 2.5% (1:40) cross fall towards the back edge of the hard standing.
- 4. Minimum dimensions for passing place should be 2000mm long x 1500mm wide.



This standard detail is indicative only and not intended to be relied upon in specific site cases. A designer should satisfy themselves of site conditions and vary details and dimensions to suit. Paths for All accept no liability for any inaccuracies or for any loss, expense, damage or injury or accident arising from the use or application of information contained here in.

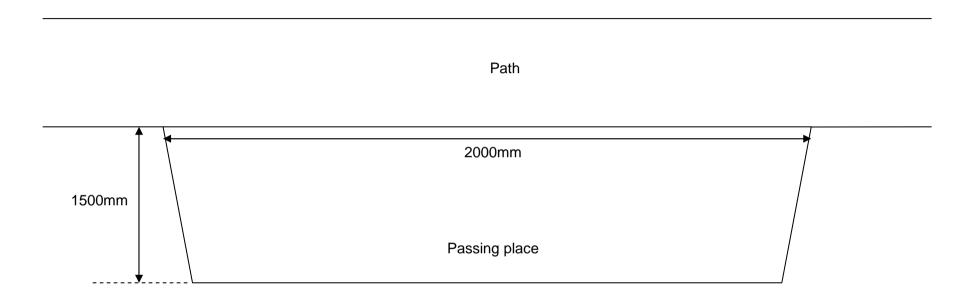

Passing Place Standard Detail Date: 06/02/12

Scale: Not to scale

Drawn by: Technical Officer

Drawing nr: SD/PP/01